

NORTH NOTE:
 NORTH SHOWN HAS BEEN ESTABLISHED USING THE USGS QUADRANGLE 7.5 MINUTE MAPS AND IS APPROXIMATE. VERIFY TRUE NORTH PRIOR TO INSTALLATION OF ANTENNAS.

LEGEND	
	EXISTING
	NEW


NEW CINGULAR WIRELESS PCS, LLC
 340 MOUNT KEMBLE AVENUE
 MORRISTOWN, NJ 07960

BLACK & VEATCH CORPORATION
 45 EISENHOWER DRIVE SUITE 240
 PARAMUS, NJ 07652

TECTONIC Engineering & Surveying Consultants P.C.
 1279 ROUTE 300
 Newburgh, NY 12550
 Phone: (845) 567-6656
 Fax: (845) 567-8703
 www.tectonicengineering.com

PROJECT NO:	6307.321G4041
DRAWN BY:	MT
CHECKED BY:	MP

REV	DATE	DESCRIPTION
1	11/28/12	ISSUED FOR PERMIT

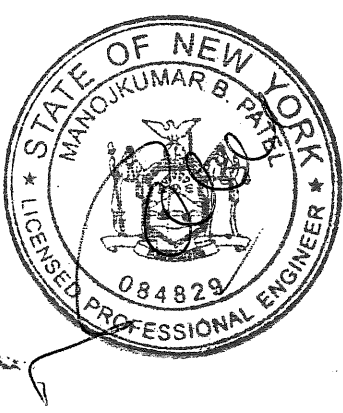


UNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING A LICENSED ENGINEER'S OR SURVEYOR'S SEAL IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK STATE EDUCATION LAW.

SITE NAME: MIDDLE HOPE
 SITE #: 321G4041
 ADDR: 21 BANNERMAN VIEW DR
 NEWBURGH, NY 12550
 LTE


SHEET TITLE
 SITE PLAN & SHELTER PLAN

SHEET NUMBER
 A-1

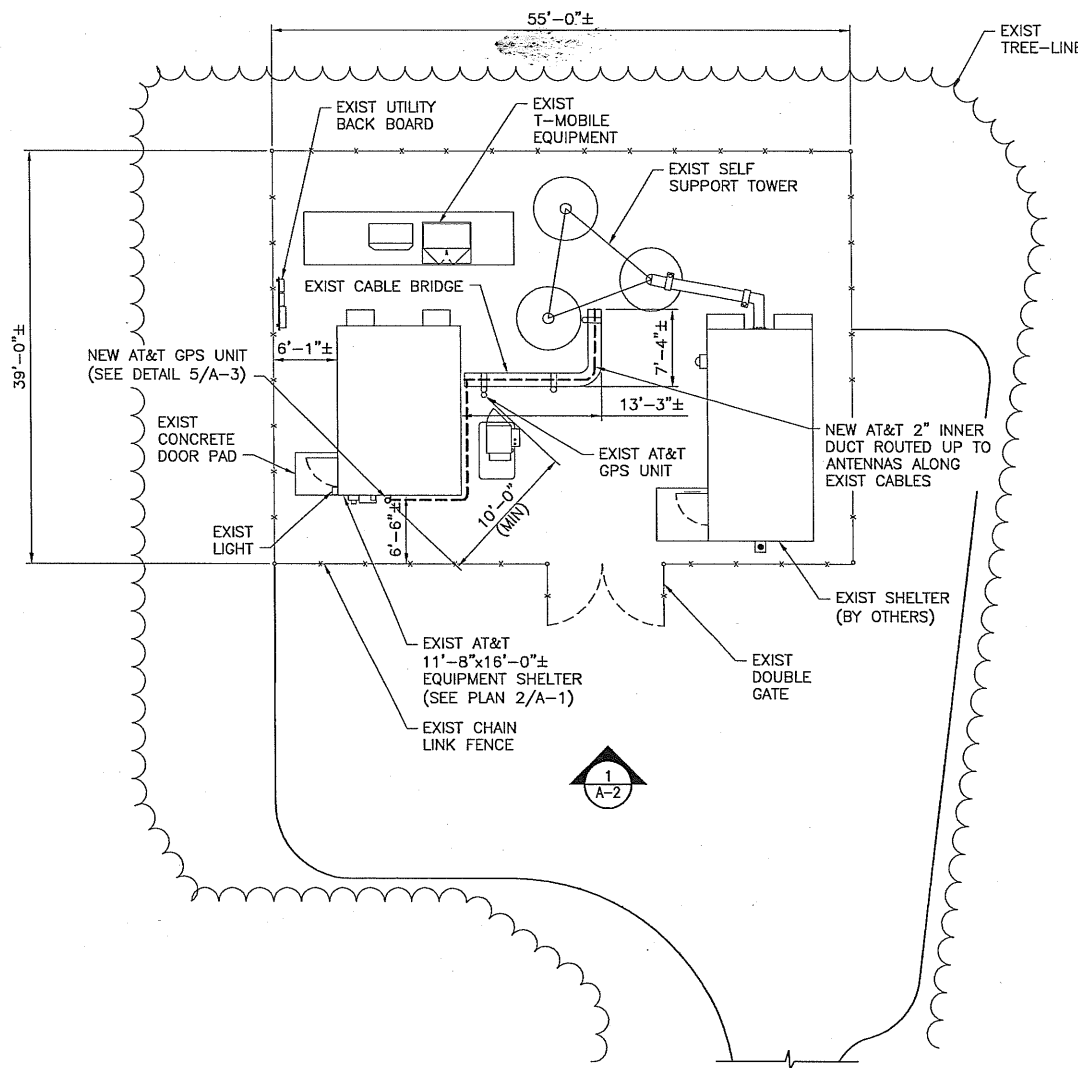


1 SITE PLAN
 A-1 SCALE: 1/8" = 1'-0"

NOTES:
 1. FOR CLARITY SITE FEATURES AS SHOWN ARE LIMITED TO THE EXISTING AND THE NEW AT&T WIRELESS INSTALLATION.
 2. CONTRACTOR SHALL MAINTAIN A 10'-0" MINIMUM SEPARATION BETWEEN THE NEW AT&T GPS AND ANY OTHER GPS/ANTENNA.

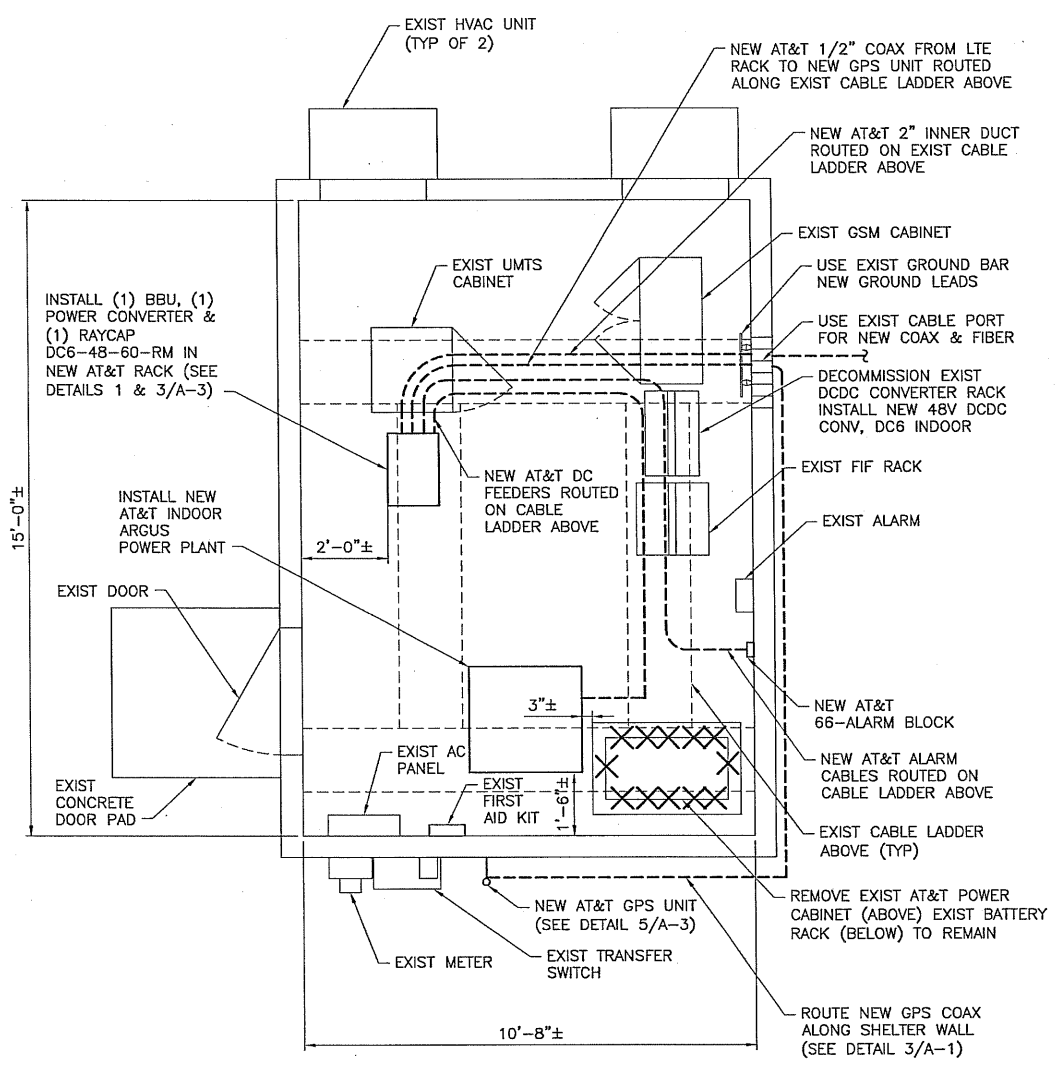


2 SHELTER PLAN
 A-1 SCALE: 1/2" = 1'-0"

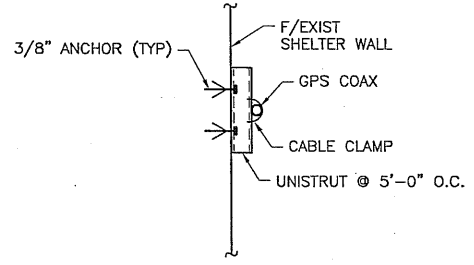

3 DETAIL
 A-1 SCALE: 1 1/2" = 1'-0"

NOTE:
 CONTRACTOR TO RELOCATE & MOVE EXIST BATTERY RACK AS REQUIRED TO ACCOMMODATE MINIMUM CLEARANCE REQUIREMENTS OF ARGUS POWER PLANT AS PER MANUFACTURER'S SPECS. IT IS ASSUMED THAT THE NEW POWER PLANT WEIGHS SAME AS EXISTING BEING REPLACED. ALL CABLING HOOK-UPS AS PER AT&T & MANUFACTURER SPECIFICATIONS.



THE EXISTING TOWER IS CURRENTLY BEING ANALYZED BY OTHERS TO DETERMINE ITS STRUCTURAL CAPACITY TO CARRY THE PROPOSED NEW COAX AND ANTENNAS. THESE DRAWINGS HAVE BEEN CREATED BASED ON THE ASSUMPTION THAT THE STRUCTURAL ANALYSIS WILL SHOW THAT THE TOWER HAS SUFFICIENT CAPACITY TO SUPPORT THE PROPOSED NEW LOADS. INSTALLATION OF THE COAX AND ANTENNAS SHALL NOT COMMENCE UNTIL AN APPROVED STRUCTURAL ANALYSIS HAS BEEN RECEIVED BY THE OWNER OR AT&T AND HAS BEEN REVIEWED BY BLACK & VEATCH.

NORTH NOTE:
NORTH SHOWN HAS BEEN ESTABLISHED USING THE USGS QUADRANGLE 7.5 MINUTE MAPS AND IS APPROXIMATE. VERIFY TRUE NORTH PRIOR TO INSTALLATION OF ANTENNAS.


LEGEND

---	EXISTING
---	NEW

ANTENNA AND TRANSMISSION CABLES REQUIREMENT


SECTOR	ANTENNA TYPE	TECHNOLOGY	ANTENNA AZIMUTH	STATUS	TRANSMISSION CABLE	
					QTY.	LENGTH TYPE
A1	DECIBEL DB874H105-SX	GSM	30°	REMAIN	1	95' 1 5/8" COAX
A2	DECIBEL DB874H105-SX	GSM	30°	REMAIN	1	95' 1 5/8" COAX
A3	ANDREW DBXLH-8585A-VTM	UMTS	30°	REMAIN	2	95' 1 5/8" COAX
A4	ANDREW SBNH-1D6565A	LTE	30°	NEW	1	95' FIBER
B1	DECIBEL DB874H105-SX	GSM	170°	REMAIN	1	95' 1 5/8" COAX
B2	DECIBEL DB874H105-SX	GSM	170°	REMAIN	1	95' 1 5/8" COAX
B3	ANDREW DBXLH-8585A-VTM	UMTS	170°	REMAIN	2	95' 1 5/8" COAX
B4	ANDREW SBNH-1D6565A	LTE	170°	NEW	1	95' FIBER
C1	DECIBEL DB874H105-SX	GSM	270°	REMAIN	1	95' 1 5/8" COAX
C2	DECIBEL DB874H105-SX	GSM	270°	REMAIN	1	95' 1 5/8" COAX
C3	ANDREW DBXLH-8585A-VTM	UMTS	270°	REMAIN	2	95' 1 5/8" COAX
C4	ANDREW SBNH-1D6565A	LTE	270°	NEW	1	95' FIBER
GPS	-	-	-	NEW	1	30' 1/2" COAX

NOTE: FIBER LENGTHS PROVIDED ARE ESTIMATED BASED ON VISUAL INSPECTION FROM GROUND AND INFORMATION PROVIDED BY THE CLIENT.

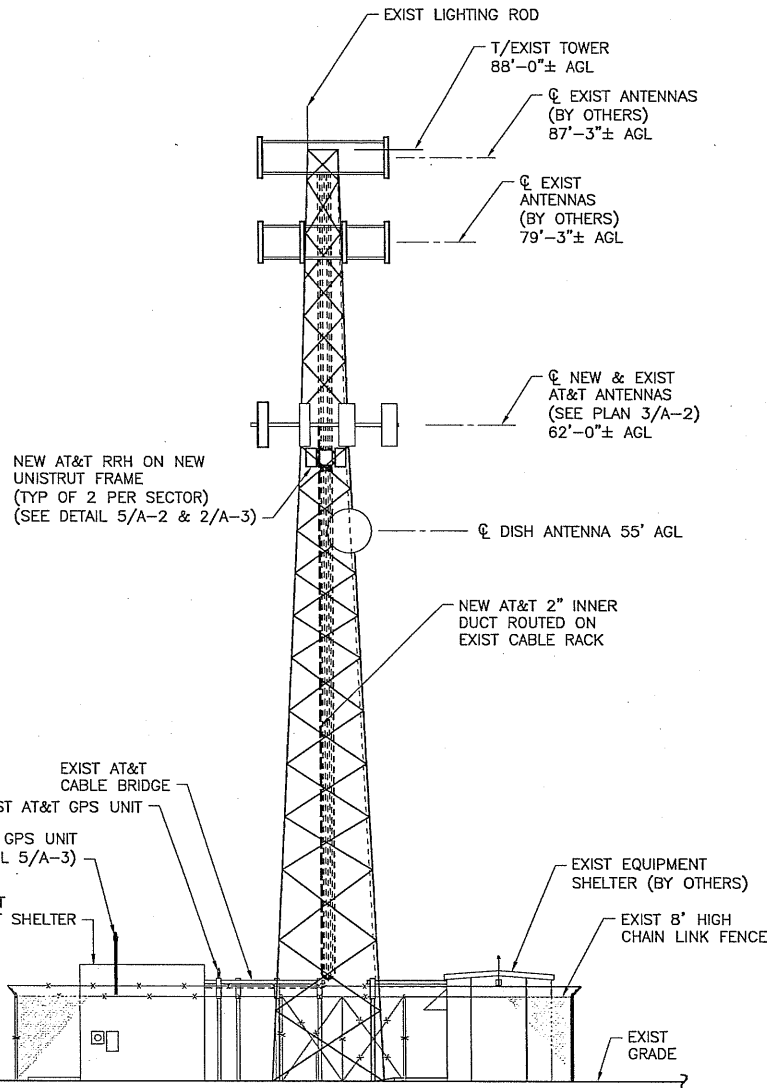


- NOTES:**
- FOR CLARITY SITE FEATURES AS SHOWN ARE LIMITED TO THE EXISTING AND THE NEW AT&T WIRELESS INSTALLATION.
 - CONTRACTOR SHALL FIELD VERIFY THE ADEQUACY TO ROUTE THE INNERDUCT PRIOR TO CONSTRUCTION. FIELD LOCATION SHALL BE IN ACCORDANCE WITH THE STRUCTURAL ANALYSIS REPORT (BY OTHERS) AND SHALL BE APPROVED BY THE CONSTRUCTION MANAGER.
 - CONTRACTOR SHALL MAINTAIN A 10'-0" MINIMUM SEPARATION BETWEEN THE NEW AT&T-GPS AND ANY OTHER GPS/ANTENNA.
 - ONE (1) RET 1/2" CABLE WILL BE INSTALLED IF REQUIRED FROM THE AT&T GROUND EQUIPMENT TO THE ANTENNAS ALONG EXISTING COAX CABLES. ADDITIONALLY, IF THE TRANSMISSION CABLE LENGTH IS TO EXCEED 197', AND ANDREWS RET CABLE GROUNDING KIT (ATGK-CABLE) WILL NEED TO BE INSTALLED AT MIDPOINT OF CABLE RUN.

1 ELEVATION
A-2 SCALE: 1/8" = 1'-0"

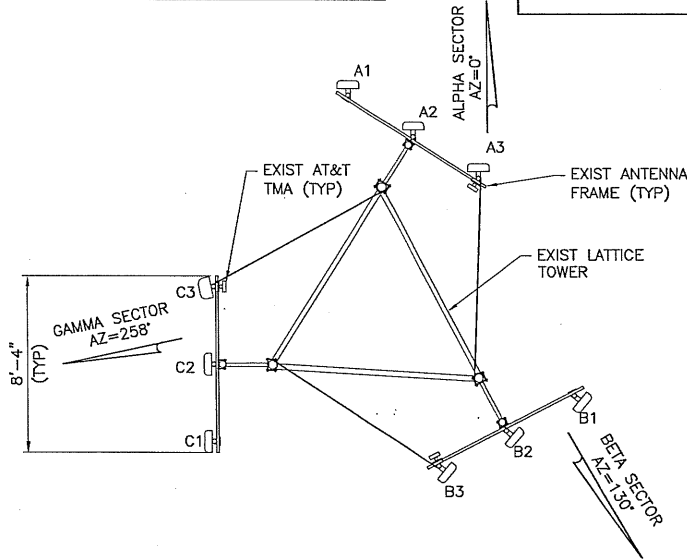


2 EXIST ANTENNA PLAN
A-2 SCALE: 1/4" = 1'-0"

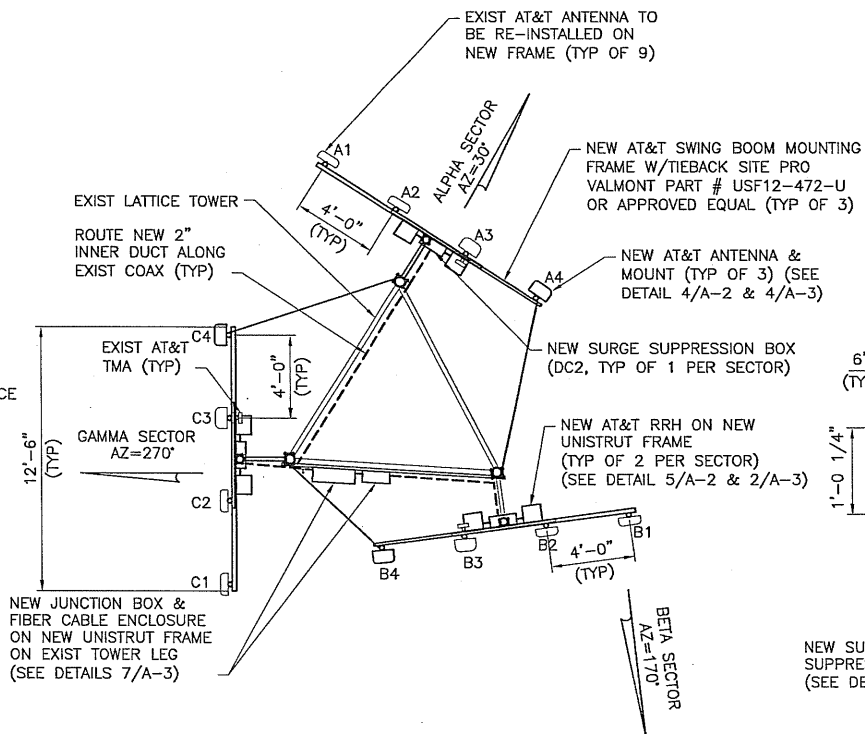


- NOTES:**
- LOCATION OF NEW APPURTENANCES AS SHOWN IS GENERIC. CONTRACTOR SHALL INSTALL THE UNITS AS NOTED IN THE STRUCTURAL ANALYSIS REPORT (BY OTHERS) AND APPROVED BY THE CONSTRUCTION MANAGER.
 - CONTRACTOR TO RE-INSTALL EXIST TMA'S ON NEW ANTENNA FRAME AS REQUIRED.

3 NEW ANTENNA PLAN
A-2 SCALE: 1/4" = 1'-0"

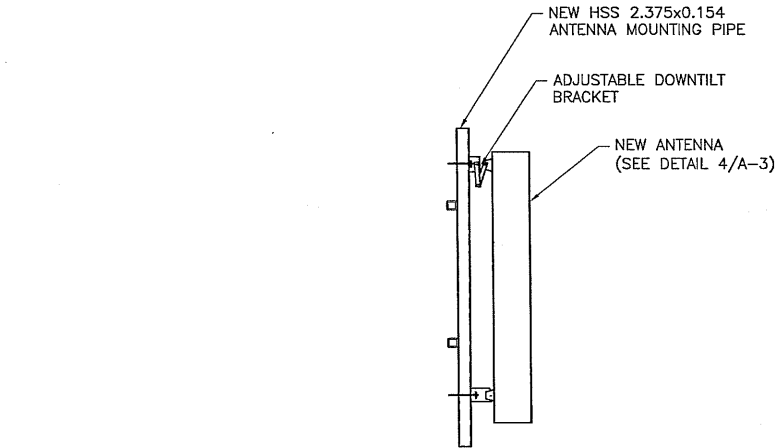

4 SECTION
A-2 SCALE: 3/4" = 1'-0"

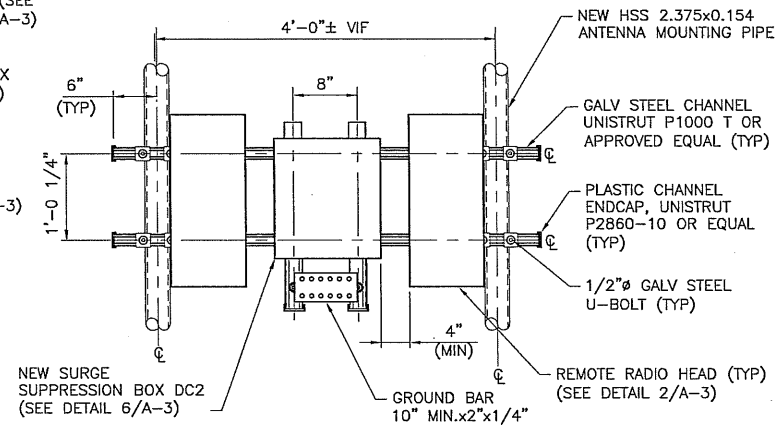

NOTE: MOUNTING OF RRH TO UNISTRUT CHANNEL SHALL BE PER MANUFACTURER DIRECTION. SEPARATION OF CHANNELS SHALL BE PER MANUFACTURER'S MOST CURRENT SPECIFICATION/INSTRUCTIONS.

5 RRH FRAME DETAIL
A-2 SCALE: N.T.S.

LTE FIBER LENGTHS

JUNCTION BOX	JUNCTION BOX TO SECTOR LTE ANTENNA		
	ALPHA	BETA	GAMMA
95'±	13'±	12'±	8'±



NEW CINGULAR WIRELESS PCS, LLC
340 MOUNT KEMBLE AVENUE
MORRISTOWN, NJ 07960



BLACK & VEATCH

BLACK & VEATCH CORPORATION
45 EISENHOWER DRIVE SUITE 240
PARAMUS, NJ 07652



- PLANNING
- ENGINEERING
- SURVEYING
- CONSTRUCTION MANAGEMENT

TECTONIC Engineering & Surveying Consultants P.C.
1279 ROUTE 300
Newburgh, NY 12550
Phone: (845) 567-6658
Fax: (845) 567-8703
www.tectonicengineering.com


PROJECT NO: 6307.321G4041

DRAWN BY: MT

CHECKED BY: MP

11/28/12 ISSUED FOR PERMIT

REV DATE DESCRIPTION

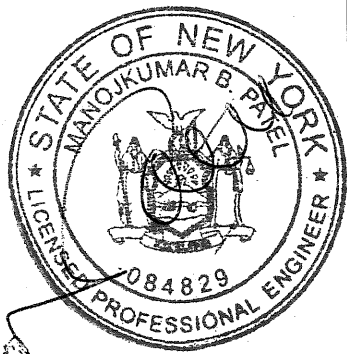


UNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING A LICENSED ENGINEER'S OR SURVEYOR'S SEAL IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK STATE EDUCATION LAW.

SITE NAME: MIDDLE HOPE
SITE #: 321G4041
ADDR: 21 BANNERMAN VIEW DR
NEWBURGH, NY 12550
LTE

SHEET TITLE
ELEVATION, ANTENNA
PLANS & DETAILS

SHEET NUMBER
A-2

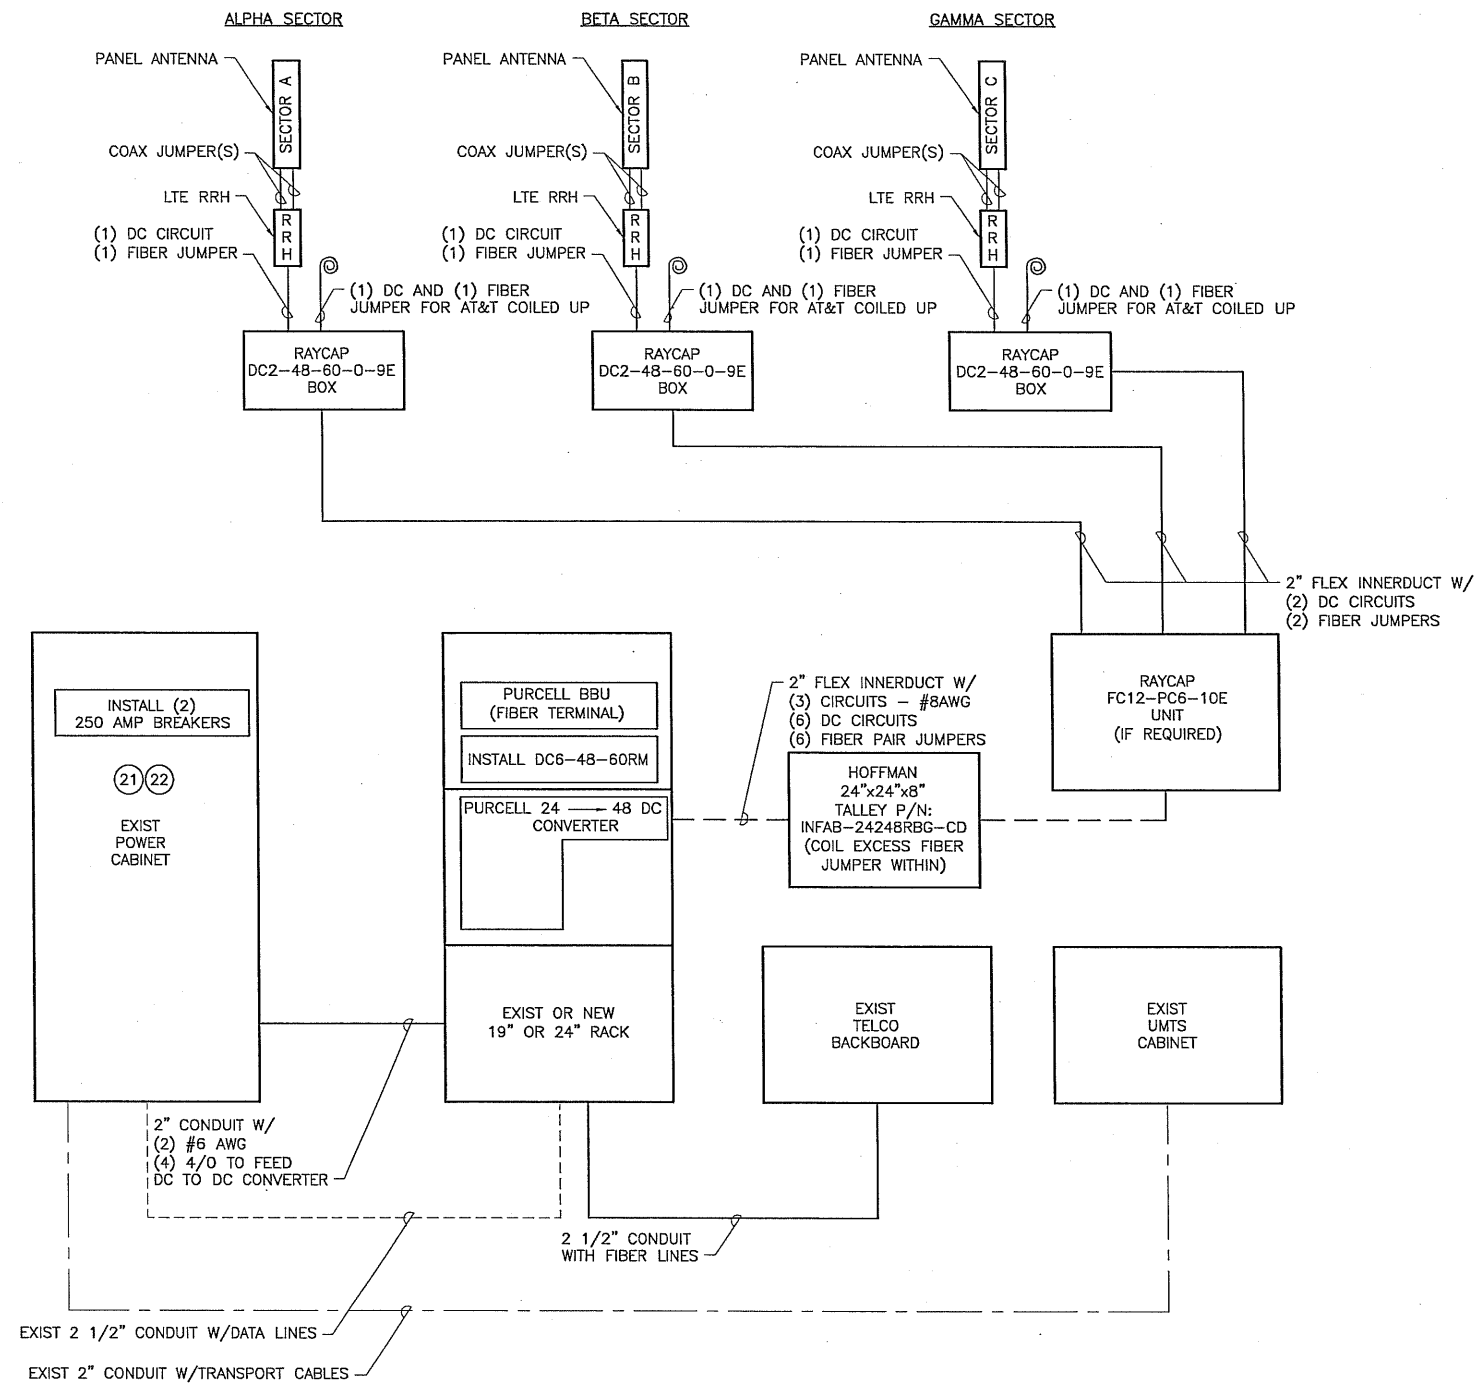

NOTE: TECTONIC TAKES NO LIABILITY OR RESPONSIBILITY FOR THE ONE-LINE DIAGRAM SHOWN ABOVE. THIS IS A GENERIC DIAGRAM PROVIDED BY THE CLIENT. CONTRACTOR SHALL THEREFORE, FIELD VERIFY EXISTING CONDITIONS PRIOR TO IMPLEMENTATION.

SAMPLE: TO BE UPDATED UPON RECEIPT OF FINAL DESIGN FROM BLACK & VEATCH.


1 ONE-LINE DIAGRAM
E-1 SCALE: NTS

- ### ELECTRICAL NOTES
1. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING AND COORDINATING ALL REQUIRED LOCAL BUILDING DEPARTMENT INSPECTIONS AND APPROVALS. ALL ELECTRICAL WORK IS TO BE PERFORMED BY AN INDIVIDUAL LICENSED IN THE JURISDICTION OF THE PROPOSED WORK.
 2. THE ENTIRE SYSTEM SHALL CONFORM TO ALL STATE AND LOCAL BUILDING CODES AND THE LATEST ADOPTED ADDITION OF THE NATIONAL ELECTRIC CODE.
 3. THE CONTRACTOR SHALL FURNISH AND INSTALL ALL ITEMS INDICATED ON THESE DRAWINGS.
 4. ALL EXTERIOR DEVICES SHALL BE RATED FOR EXTERIOR USE "3R".
 5. THE CONTRACTOR IS RESPONSIBLE FOR ALL CLEARING AND EXCAVATING FOR NEW UTILITY POLES OR UNDERGROUND UTILITY RUNS. COORDINATE WITH THE LOCAL UTILITY COMPANIES TO DETERMINE WHAT DEVICES ARE SUPPLIED AND INSTALLED AS THE SECONDARY ELECTRIC AND TELEPHONE SERVICE VERSUS UTILITY COMPANIES RESPONSIBILITIES.
 6. ALL MATERIALS AND DEVICES INSTALLED SHALL BE NEW AND IN WORKING ORDER. DEVICES AND MATERIALS SHALL BE LISTED AND BEAR THE "UL" SEAL OF APPROVAL AND INSPECTION LABEL "J".
 7. THE CONTRACTOR IS TO DEMONSTRATE TO A CLIENT'S PROJECT MANAGER THAT THE SYSTEM IS FULLY ENERGIZED AND WORKING AS INTENDED. CONDUCT CONTINUITY, SHORT CIRCUIT AND FALL OF POTENTIAL GROUNDING TEST. SUBMIT TEST RESULTS TO THE PROJECT MANAGER.
 8. ALL ELECTRICAL EQUIPMENT SHALL BE LABELED WITH PERMANENT ENGRAVED PLASTIC LABELS.
 9. EACH CONDUCTOR OF EVERY SYSTEM SHALL BE PERMANENTLY TAGGED IN EACH PANEL BOARD, PULL BOX, J-BOX, SWITCH PLATE, ETC., IN COMPLIANCE WITH OSHA.
 10. LABEL EACH PANEL BOARD CIRCUIT DIRECTORY CARD, IDENTIFY THE "LOAD SERVED", "SPARE" OR "SPACE"
 11. THE ENTIRE ELECTRICAL SYSTEM SHALL BE GROUNDED. GROUNDING SHALL BE #2 AWG SOLID TINNED ANNEALED COPPER, UNLESS OTHERWISE NOTED.
 12. THE CONTRACTOR IS RESPONSIBLE FOR ALL TRENCHING, BACK FILLING AND REPAIRING OF EXISTING SURFACES CUT AND REMOVED FOR UNDERGROUND UTILITY RUNS.
 13. THE CONTRACTOR IS RESPONSIBLE FOR ALL CUTTING, PATCHING, DRILLING, CHASING, HOLES AND SLEEVES IN EXISTING BUILDING WALLS AND FLOORS REQUIRED TO INSTALL THE NEW ELECTRICAL SERVICE, FIRE RATED WALL SHALL BE PATCH WITH 3M FIRE SEAL OR EQUAL, RATING AS REQUIRED. ALL PENETRATIONS THRU EXTERIOR WALLS SHALL BE CAULKED WEATHER TIGHT.
 14. THE CONTRACTOR IS TO SUPPLY ALL HANGERS, SUPPORTS, FASTENERS AND HARDWARE FOR A COMPLETE INSTALLATION. ALL OF THE ABOVE SHALL BE ZINC-COATED. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL FIELD CONDITIONS PRIOR TO ORDERING LENGTHS OF MATERIAL.
 15. PRIOR TO THE WIRE INSTALLATION OR BACK FILL OF THE UTILITY TRENCH, THE CONTRACTOR IS TO COORDINATE ALL INSPECTIONS OF THE CONDUIT, SWEEPS AND ANY UTILITY POLE RISERS WITH THE LOCAL UTILITY COMPANY.
 16. ALL SECONDARY CONDUITS USED FOR EXTERIOR UNDERGROUND UTILITIES SHALL BE PVC SCHEDULE #40, SCHEDULE #80 UNDER ROADWAYS. MINIMUM BEND RADIUS SHALL BE 36". ALL CONDUITS SHALL HAVE MINIMUM OF TWO (2) DRAG LINES. PULL BOXES ARE TO BE INSTALLED WHEN LENGTHS EXCEED 100 FEET. COORDINATE SIZE OF CONDUITS REQUIRED BY THE UTILITY COMPANIES.
 17. ALL CIRCUIT BREAKERS, FUSES AND FIELD INSTALLED ELECTRICAL EQUIPMENT SHALL HAVE AN INTERRUPTING RATING NOT LESS THAN THE MAXIMUM SHORT CIRCUIT TO WHICH THEY MAY BE SUBJECT AND MINIMUM RATING OF 22,000 A.I.C.
 18. GENERAL CONTRACTOR IS TO COORDINATE ALL OF HIS WORK TO MINIMIZE THE DISTURBANCE TO THE EXISTING SITE OCCUPANTS' WORKERS OR ACCESS REQUIRED BY THE GENERAL PUBLIC OR MAINTENANCE PERSONNEL.
 19. ANY DISRUPTION OF THE EXISTING ELECTRICAL SERVICE MUST BE COORDINATED WITH THE OTHER SITE OCCUPANTS.
 20. ANY DISRUPTION OF THE EXISTING SITE CONDITIONS SHALL BE RETURNED TO THEIR PREVIOUS CONDITION OR BETTER.
 21. BBU REQUIRES ONE (1) 1/0 CIRCUIT WITH SINGLE POLE 60 AMP BREAKER.
 22. RRH REQUIRES THREE (3) #8 CIRCUITS WITH THREE (3) SINGLE POLE 10 AMP BREAKERS.



PROJECT NO:	6307.321G4041
DRAWN BY:	MT
CHECKED BY:	MP

REV	DATE	DESCRIPTION
1	11/28/12	ISSUED FOR PERMIT

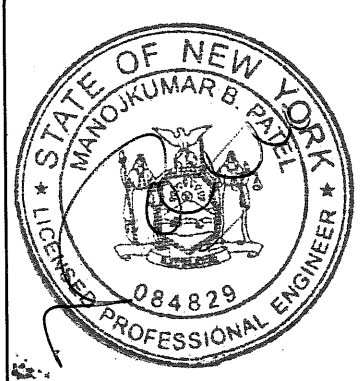



UNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING A LICENSED ENGINEER'S OR SURVEYOR'S SEAL IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK STATE EDUCATION LAW.

SITE NAME: MIDDLE HOPE
SITE #: 321G4041
ADDR: 21 BANNERMAN VIEW DR
NEWBURGH, NY 12550
LTE

SHEET TITLE
ELECTRICAL DC
ONE-LINE DIAGRAM

SHEET NUMBER
E-1



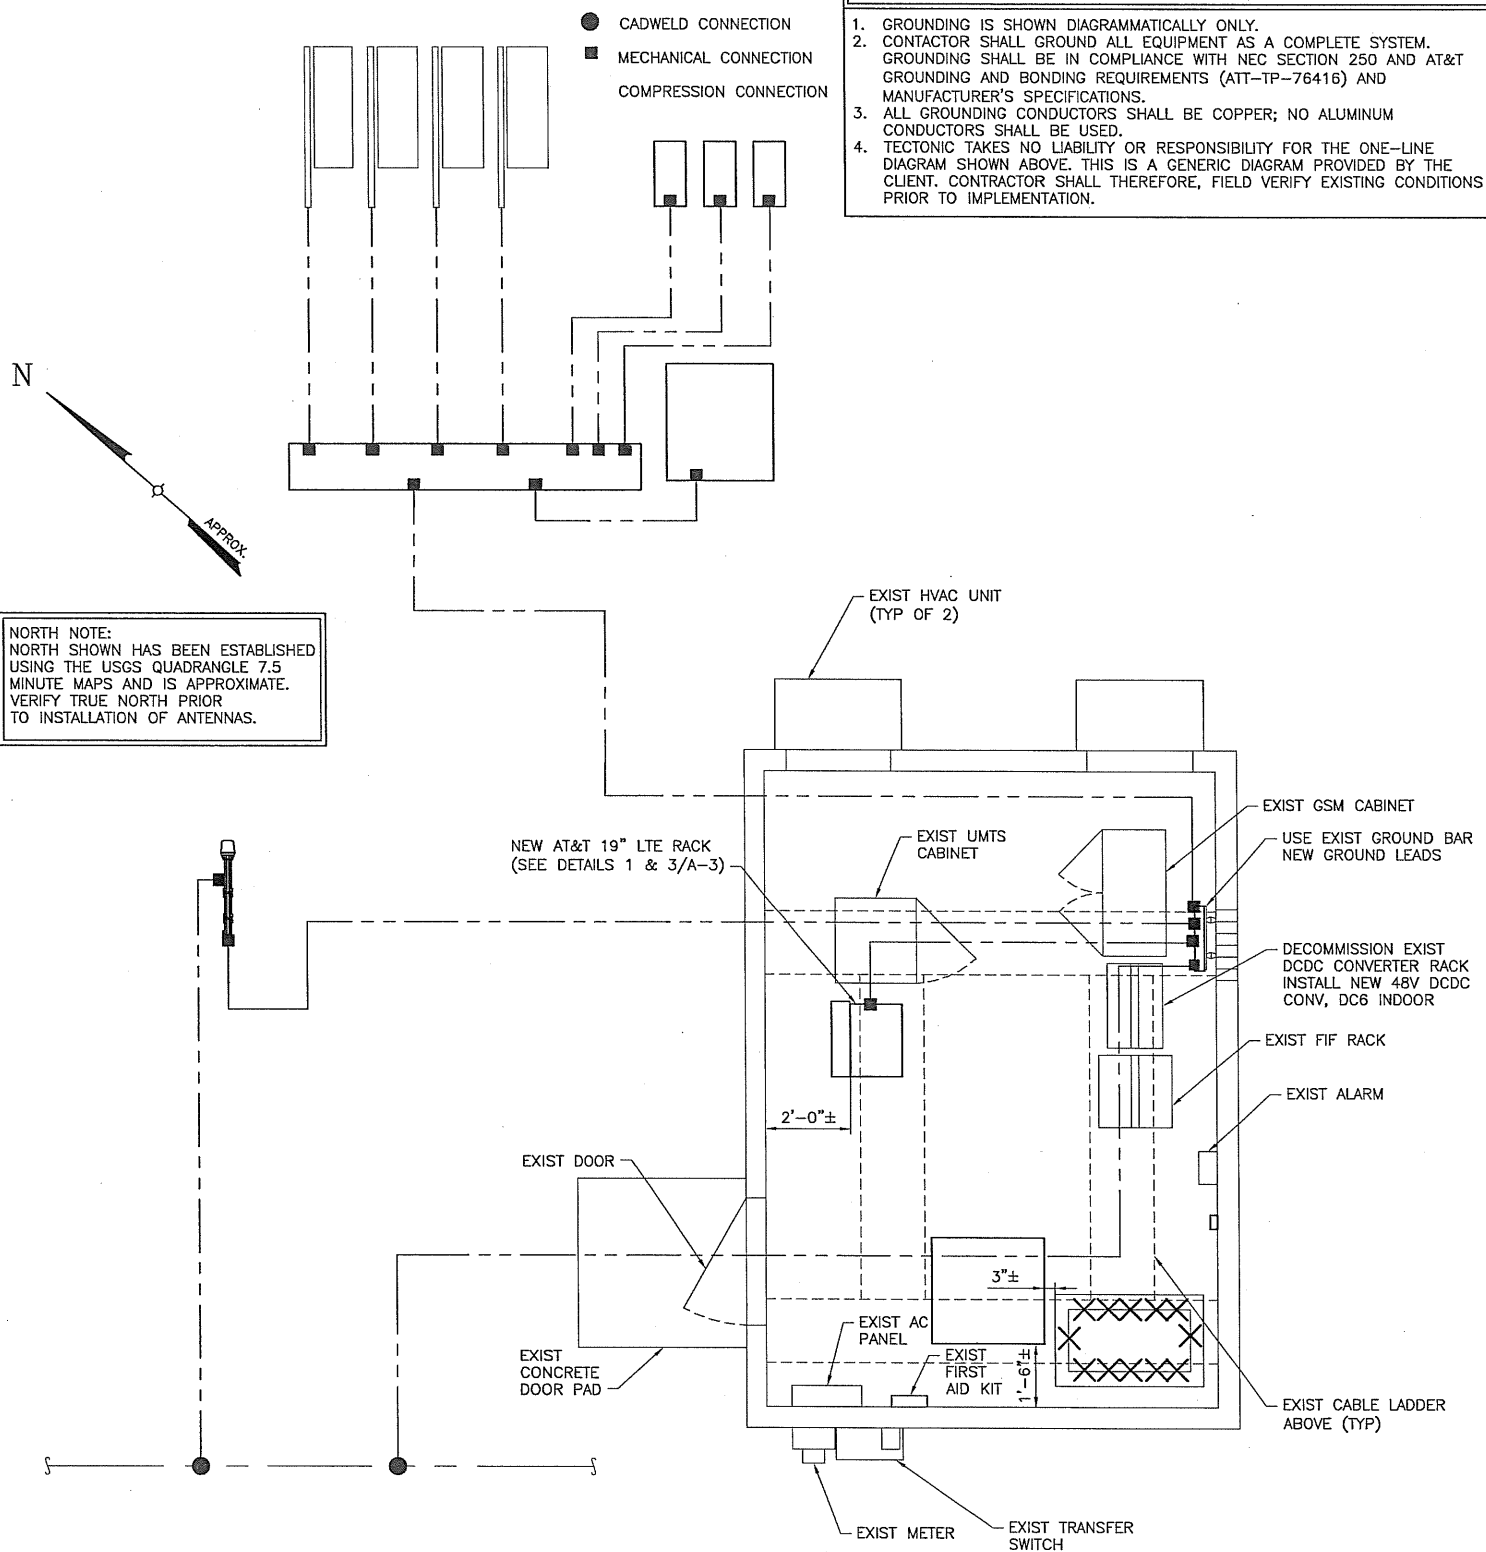



NORTH NOTE:
NORTH SHOWN HAS BEEN ESTABLISHED USING THE USGS QUADRANGLE 7.5 MINUTE MAPS AND IS APPROXIMATE. VERIFY TRUE NORTH PRIOR TO INSTALLATION OF ANTENNAS.

- NOTES**
- GROUNDING IS SHOWN DIAGRAMMATICALLY ONLY.
 - CONTACTOR SHALL GROUND ALL EQUIPMENT AS A COMPLETE SYSTEM. GROUNDING SHALL BE IN COMPLIANCE WITH NEC SECTION 250 AND AT&T GROUNDING AND BONDING REQUIREMENTS (ATT-TP-76416) AND MANUFACTURER'S SPECIFICATIONS.
 - ALL GROUNDING CONDUCTORS SHALL BE COPPER; NO ALUMINUM CONDUCTORS SHALL BE USED.
 - TECTONIC TAKES NO LIABILITY OR RESPONSIBILITY FOR THE ONE-LINE DIAGRAM SHOWN ABOVE. THIS IS A GENERIC DIAGRAM PROVIDED BY THE CLIENT. CONTRACTOR SHALL THEREFORE, FIELD VERIFY EXISTING CONDITIONS PRIOR TO IMPLEMENTATION.

- GROUNDING KEY NOTES**
- EXTERIOR GROUND RING: #2 AWG SOLID COPPER, BURIED AT A DEPTH OF AT LEAST 30 INCHES BELOW GRADE, OR 6 INCHES BELOW THE FROST LINE AND APPROXIMATELY 24 INCHES FROM THE EXTERIOR WALL OR FOOTING. (ATT-TP-76416 2.2.3.5/7.5.1)
 - TOWER GROUND RING: THE GROUND RING SYSTEM SHALL BE INSTALLED AROUND AN ANTENNA TOWER'S LEGS, AND/OR GUY ANCHORS. WHERE SEPARATE SYSTEMS HAVE BEEN PROVIDED FOR THE TOWER AND THE BUILDING, AT LEAST TWO BONDS SHALL BE MADE BETWEEN THE TOWER RING GROUND SYSTEM AND THE BUILDING RING GROUND SYSTEM USING MINIMUM #2 AWG SOLID COPPER CONDUCTORS. (ATT-TP-76416 7.5.1)
 - INTERIOR GROUND RING: #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTOR EXTENDED AROUND THE PERIMETER OF THE EQUIPMENT AREA. ALL NON-TELECOMMUNICATIONS RELATED METALLIC OBJECTS FOUND WITHIN A SITE SHALL BE GROUNDED TO THE INTERIOR GROUND RING WITH #6 AWG STRANDED GREEN INSULATED CONDUCTOR. (ATT-TP-76416 7.6.4)
 - BOND TO INTERIOR GROUND RING: #2 AWG SOLID TINNED COPPER WIRE PRIMARY BONDS SHALL BE PROVIDED AT LEAST AT FOUR POINTS ON THE INTERIOR GROUND RING, LOCATED AT THE CORNERS OF THE BUILDING. (ATT-TP-76416 7.5.2.2)
 - GROUND ROD: UL LISTED COPPER CLAD STEEL, MINIMUM 5/8" DIAMETER BY EIGHT FEET LONG. ALL GROUND RODS SHALL BE INSTALLED WITH INSPECTION SLEEVES. GROUND RODS SHALL BE DRIVEN TO THE DEPTH OF GROUND RING CONDUCTOR. (ATT-TP-76416 1.4 / 7.5.1)
 - CELL REFERENCE GROUND BAR: POINT OF GROUND REFERENCE FOR ALL COMMUNICATIONS EQUIPMENT FRAMES. ALL BONDS ARE MADE WITH #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS. BOND TO GROUND RING WITH (2) #2 SOLID TINNED COPPER CONDUCTORS. (ATT-76416 7.6.5)
 - HATCH PLATE GROUND BAR: BOND TO THE INTERIOR GROUND RING WITH TWO #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS. WHEN A HATCH-PLATE AND A CELL REFERENCE GROUND BAR ARE BOTH PRESENT, THE CRGB MUST BE CONNECTED TO THE HATCH-PLATE AND TO THE INTERIOR GROUND RING USING TWO #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS.
 - EXTERIOR CABLE ENTRY PORT GROUND BARS: LOCATED AT THE ENTRANCE TO THE CELL SITE BUILDING. BOND TO GROUND RING WITH A #2 AWG SOLID TINNED COPPER CONDUCTORS WITH AN EXOTHERMIC WELD AND INSPECTION SLEEVE. (ATT-TP-76416 7.6.7.2)
 - TOWER EXIT GROUND BAR: #2 AWG SOLID TINNED COPPER BOND TO THE TOWER GROUND RING. (ATT-TP-76416 7.55)
 - TELCO GROUND BAR: BOND TO BOTH CELL REFERENCE GROUND BAR AND EXTERIOR GROUND RING. (ATT-TP-76416 7.6.8)
 - FRAME BONDING: THE BONDING POINT FOR TELECOM EQUIPMENT FRAMES SHALL BE THE GROUND BUS THAT IS NOT ISOLATED FROM THE EQUIPMENT'S METAL FRAMEWORK. BOND THE FRAME GROUND BUS TO THE "I" SECTION OF THE CELL REFERENCE GROUND BAR. (ATT-TP-76416 7.8)
 - INTERIOR UNIT BONDS: METAL FRAMES, CABINETS AND INDIVIDUAL METALLIC UNITS LOCATED WITH THE AREA OF THE INTERIOR GROUND RING REQUIRE A #6 AWG STRANDED GREEN INSULATED COPPER BOND TO THE INTERIOR GROUND RING. (ATT-TP-76416 7.12.3.1)
 - FENCE AND GATE GROUND: METAL FENCES WITHIN 7 FEET OF THE EXTERIOR GROUND RING OR OBJECTS BONDED TO THE EXTERIOR GROUND RING SHALL BE BONDED TO THE GROUND RING WITH A #2 AWG SOLID TINNED COPPER CONDUCTOR AT AN INTERVAL NOT EXCEEDING 25 FEET. BONDS SHALL BE MADE AT EACH GATE POST AND ACROSS GATE OPENINGS. (ATT-TP-76416 7.12.2.2)
 - EXTERIOR UNIT BONDS: METALLIC OBJECTS, EXTERNAL TO OR MOUNTED TO THE BUILDING, SHALL BE BONDED TO THE EXTERIOR GROUND RING. (ATT-TP-76416 7.4.2.6)
 - ICE BRIDGE SUPPORTS: EACH ICE BRIDGE LEG SHALL BE BONDED TO THE GROUND RING WITH #2 AWG BARE TINNED COPPER CONDUCTOR. PROVIDE EXOTHERMIC WELDS AT BOTH THE ICE BRIDGE LEG AND BURIED GROUND RING. (ATT-TP-76416 7.4.2.6)


- GROUNDING NOTES**
- THE ENTIRE ELECTRICAL INSTALLATION SHALL BE GROUNDED AS REQUIRED BY ALL APPLICABLE CODES.
 - ALL GROUNDING WORK SHALL BE IN ACCORDANCE WITH AT&T.
 - ALL BUS CONNECTORS SHALL BE TWO-HOLE, LONG-BARREL TYPE COMPRESSION LUGS, T&B OR EQUAL, UNLESS OTHERWISE NOTED ON DRAWINGS. ALL LUGS SHALL BE ATTACHED TO BUSES USING BOLTS, NUTS, AND LOCK WASHERS. NO WASHERS ARE ALLOWED BETWEEN THE ITEMS BEING GROUNDED.
 - ALL CONNECTORS SHALL BE CRIMPED USING HYDRAULIC CRIMPING TOOLS, T&B #TBM 8 OR EQUIVALENT.
 - ALL CONNECTIONS SHALL BE MADE TO BARE METAL. ALL PAINTED SURFACES SHALL BE FILED TO ENSURE PROPER CONTACT. NO WASHERS ARE ALLOWED BETWEEN THE ITEMS BEING GROUNDED. ALL CONNECTIONS ARE TO HAVE A NON-OXIDIZING AGENT APPLIED PRIOR TO INSTALLATION.
 - ALL COPPER BUSES SHALL BE CLEANED, POLISHED, AND A NON-OXIDIZING AGENT APPLIED. NO FINGERPRINTS OR DISCOLORED COPPER WILL BE PERMITTED.
 - ALL BENDS SHALL BE AS SHALLOW AS POSSIBLE, WITH NO TURN SHORTER THAN AN 8-INCH NOMINAL RADIUS.
 - GROUNDING CONDUCTORS SHALL BE SOLID TINNED COPPER AND ANNEALED #2. ALL GROUNDING CONDUCTORS SHALL RUN THROUGH PVC SLEEVES WHEREVER CONDUCTORS RUN THROUGH WALLS, FLOORS, OR CEILINGS. IF CONDUCTORS MUST RUN THROUGH EMT, BOTH ENDS OF CONDUIT SHALL BE GROUNDED. SEAL BOTH ENDS OF CONDUIT WITH SILICONE CAULK.
 - GROUNDING SYSTEM RESISTANCE SHALL NOT EXCEED 10 OHMS. IF THE RESISTANCE VALUE IS EXCEEDED, NOTIFY THE PROJECT MANAGER FOR FURTHER INSTRUCTION ON METHODS FOR REDUCING THE RESISTANCE VALUE.
 - ALL ROOF TOP ANTENNA MOUNTS SHALL BE GROUNDED WITH A #2 GROUND WIRE CONNECTED TO THE NEAREST GROUND BUS. ALL CONNECTIONS ARE TO BE CAD-WELDED IF POSSIBLE.
 - UPON COMPLETION OF WORK, CONDUCT CONTINUITY, SHORT CIRCUIT, AND FALL OF POTENTIAL GROUNDING TESTS FOR APPROVAL. SUBMIT TEST REPORTS TO THE PROJECT MANAGER.
 - GROUNDING CONNECTION TO TRAVEL IN A DOWNWARD DIRECTION.
 - ALL EXPOSED #2 WIRE MUST BE TINNED NOT BTW.
 - EXOTHERMIC WELD (2) TWO, #2 AWG BARE TINNED SOLID COPPER CONDUCTORS TO GROUNDING BAR. ROUTE CONDUCTORS TO BURIED GROUNDING RING AND PROVIDE PARALLEL EXOTHERMIC WELD.
 - ALL GROUNDING BARS SHALL BE STAMPED IN TO THE METAL "IF STOLEN DO NOT RECYCLE." THE CONTRACTOR SHALL USE PERMANENT MARKER TO DRAW THE LINES BETWEEN EACH SECTION AND LABEL EACH SECTION ("P", "A", "N", "I") WITH 1" HIGH LETTERS.
 - ALL HARDWARE SHALL BE STAINLESS STEEL 3/8" DIAMETER OR LARGER. ALL HARDWARE 18-8 STAINLESS STEEL INCLUDING LOCK WASHERS, COAT ALL SURFACES WITH AN ANTI-OXIDANT COMPOUND BEFORE MATING.
 - FOR GROUND BOND TO STEEL ONLY: INSERT A CADMIUM FLAT WASHER BETWEEN LUG AND STEEL, COAT ALL SURFACES WITH AN ANTI-OXIDANT COMPOUND BEFORE MATING.
 - DO NOT INSTALL CABLE GROUNDING KIT AT A BEND AND ALWAYS DIRECT GROUNDING CONDUCTOR DOWN TO GROUNDING BUS.
 - NUT & WASHER SHALL BE PLACED ON THE FRONT SIDE OF THE GROUNDING BAR AND BOLTED ON THE BACK SIDE. INSTALL BLACK HEAT-SHRINKING TUBE, 600 VOLT INSULATION, ON ALL GROUNDING TERMINATIONS. THE INTENT IS TO WEATHERPROOF THE COMPRESSION CONNECTION SUPPLIED AND INSTALLED BY CONTRACTOR.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLING ADDITIONAL GROUNDING BAR AS REQUIRED, PROVIDING 50% SPARE CONNECTION POINTS.
 - ENSURE THE WIRE INSULATION TERMINATION IS WITHIN 1/8" OF THE BARREL (NO SHINERS).

1 GROUNDING PLAN
G-1 SCALE: NTS

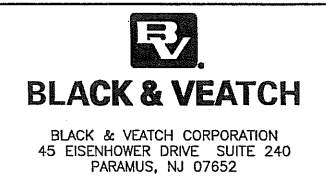

PROJECT NO:	6307.321G4041
DRAWN BY:	MT
CHECKED BY:	MP

REV	DATE	DESCRIPTION
	11/28/12	ISSUED FOR PERMIT

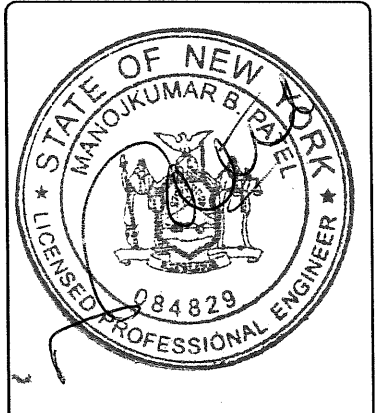


UNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING A LICENSED ENGINEER'S OR SURVEYOR'S SEAL IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK STATE EDUCATION LAW.

SITE NAME: MIDDLE HOPE
SITE #: 321G4041
ADDR: 21 BANNERMAN VIEW DR
NEWBURGH, NY 12550
LTE

SHEET TITLE
GROUNDING PLAN & NOTES

SHEET NUMBER
G-1

NEWTON INSTRUMENT COMPANY, INC. BUTNER, N.C.			
NO	REQUIRED	PART NUMBER	DESCRIPTION
①	1	1/4"x4"x48"	SOLID GROUNDING BAR
②	2	A-6056	WALL MOUNTING BRACKET
③	2	3061-4	INSULATORS
④	4	3012-1	5/8"-11x1" H.H.C.S.
⑤	4	3015-8	5/8" LOCKWASHER

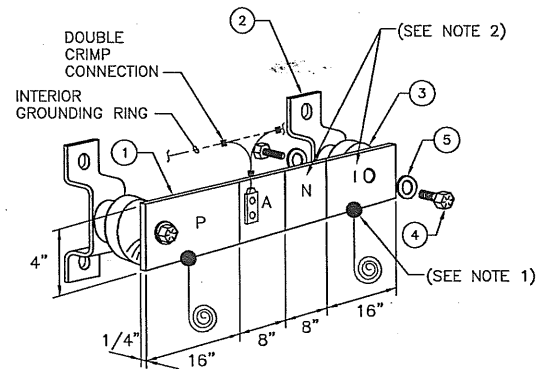

① (MGB) REFERENCE GROUNDING BAR
G-2 SCALE: NTS

EACH GROUNDING CONDUCTOR TERMINATING ON ANY GROUNDING BAR SHALL HAVE AN IDENTIFICATION TAG ATTACHED AT EACH END THAT WILL IDENTIFY ITS ORIGIN AND DESTINATION


SECTION "P" - SURGE PROTECTORS
 (EC) CELL REFERENCE GROUNDING BAR (IF COLLOCATED)
 (EC) GENERATOR FRAMEWORK (IF AVAILABLE) (#2 AWG)
 (EC) TELCO GROUNDING BAR (#2 AWG)
 (EC) COMMERCIAL POWER COMMON NEUTRAL/GROUNDING BOND (3/0)
 (EC) FIBER GROUNDING BAR (#2 AWG)
 (EC) POWER ROOM REFERENCE GROUNDING BAR (#2 AWG)
 (AT&T) RECTIFIER FRAMES

SECTION "A" - SURGE ABSORBERS
 (EC) INTERIOR GROUNDING RING (#2 AWG)
 (EC) EXTERNAL EARTH GROUNDING FIELD (BURIED GROUNDING RING) (#2 AWG)
 (EC) METALLIC COLD WATER PIPE (IF AVAILABLE) (1/0 AWG)
 (EC) BUILDING STEEL (IF AVAILABLE) (1/0 AWG)


SECTION "N" - NON-ISOLATED GROUNDING ZONE EQUIPMENT
 (EC) MISC. NON-ISOLATED GROUNDING ZONE EQUIPMENT (AT&T)-48V POWER SUPPLY RETURN BARE

SECTION "I" - ISOLATED GROUNDING ZONE
 (AT&T) ALL ISOLATED GROUNDING REFERENCE
 (AT&T) GROUNDING WINDOW BAR


GENERIC DETAILS. CONTRACTOR TO FIELD VERIFY EXISTING CONDITIONS PRIOR TO IMPLEMENTATION. CONTACT CONSTRUCTION MANAGER AND/OR DESIGN ENGINEER FOR APPROVAL.

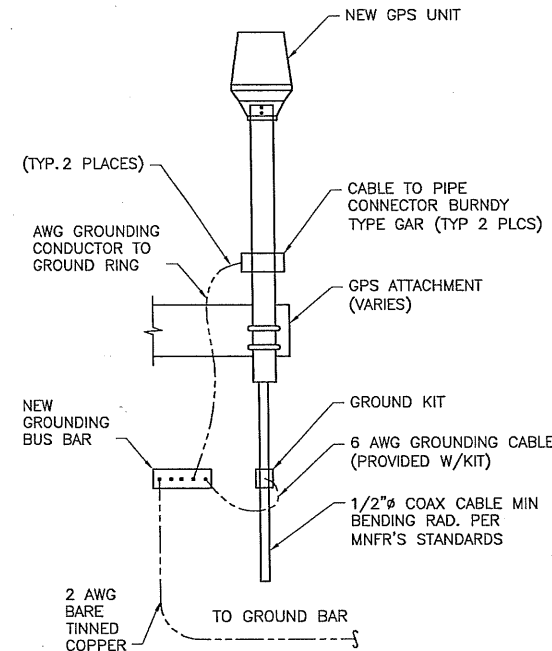


② GPS GROUND DETAIL
G-2 SCALE: NTS

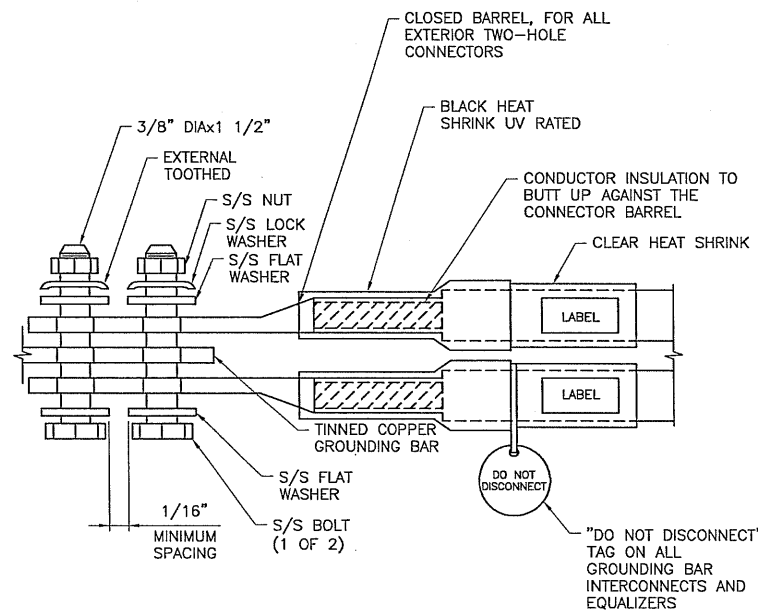

③ EXTERIOR TWO HOLE LUG DETAIL
G-2 SCALE: NTS

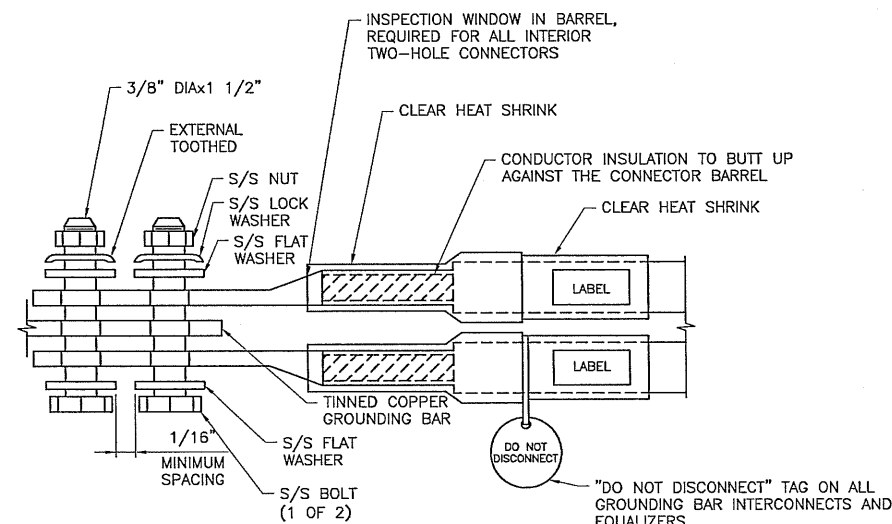

④ INTERIOR TWO HOLE LUG DETAIL
G-2 SCALE: NTS



NEW CINGULAR WIRELESS PCS, LLC
340 MOUNT KEMBLE AVENUE
MORRISTOWN, NJ 07960



BLACK & VEATCH

BLACK & VEATCH CORPORATION
45 EISENHOWER DRIVE, SUITE 240
PARAMUS, NJ 07652



• PLANNING
• ENGINEERING
• SURVEYING
• CONSTRUCTION MANAGEMENT

TECTONIC Engineering & Surveying Consultants P.C.
1279 ROUTE 300
Newburgh, NY 12550
Phone: (845) 567-8858
Fax: (845) 567-8703
www.tectonicengineering.com

PROJECT NO:	6307.321G4041
DRAWN BY:	MT
CHECKED BY:	MP

REV	DATE	DESCRIPTION
	11/28/12	ISSUED FOR PERMIT



UNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING A LICENSED ENGINEER'S OR SURVEYOR'S SEAL IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK STATE EDUCATION LAW.

SITE NAME: MIDDLE HOPE
SITE #: 321G4041
ADDR: 21 BANNERMAN VIEW DR
NEWBURGH, NY 12550
LTE

SHEET TITLE
GROUNDING DETAILS

SHEET NUMBER
G-2

GENERAL CONSTRUCTION NOTES

1. ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF THE NEW YORK STATE BUILDING CODE, LATEST VERSION AND ALL OTHER APPLICABLE CODES AND ORDINANCES.
2. EXISTING BUILDING INFORMATION WAS OBTAINED BASED ON A LIMITED SITE INSPECTION BY TECTONIC ENGINEERING.
3. OCCUPANCY IS LIMITED TO PERIODIC MAINTENANCE AND INSPECTION, APPROXIMATELY 2 TIMES PER MONTH, BY AT&T TECHNICIANS.
4. NO NOISE, SMOKE, DUST OR ODOR WILL RESULT FROM THIS PROPOSAL.
5. OUTDOOR STORAGE AND SOLID WASTE CONTAINERS ARE NOT PROPOSED.
6. ALL MATERIALS SHALL BE FURNISHED AND WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.
7. SUBCONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL PERMITS AND INSPECTIONS REQUIRED FOR CONSTRUCTION.
8. SUBCONTRACTOR SHALL BE RESPONSIBLE FOR REPAIRING ANY DAMAGE CAUSED BY THE CONSTRUCTION OPERATION.
9. SUBCONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
10. INFORMATION SHOWN ON THESE DRAWINGS IS BASED ON A LIMITED SITE INSPECTION. SUBCONTRACTOR SHALL NOTIFY BLACK & VEATCH OF ANY DISCREPANCIES PRIOR TO ORDERING MATERIALS OR PROCEEDING WITH CONSTRUCTION.
11. PROTECT EXISTING ROOFING WITH PLYWOOD OR PROTECTION BOARD IN ALL AREAS OF WORK. REPAIR ANY DAMAGE TO THE SATISFACTION OF THE BUILDING OWNER, AND MAINTAIN EXISTING ROOFING GUARANTEE BY USING OWNER'S ROOFING CONTRACTOR.

ANTENNA NOTES

1. DESIGN AND CONSTRUCTION OF ANTENNA SUPPORTS SHALL ALSO CONFORM TO ANSI/TIA-222-G-2005 "STRUCTURAL STANDARD FOR ANTENNA SUPPORTING STRUCTURES AND ANTENNAS".
2. ALL ANTENNA MOUNTS AND ASSOCIATED APPURTENANCES SHALL BE INSTALLED WITH DOUBLE NUTS AND SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
3. ALL CABLES SHALL BE GROUNDED WITH COAXIAL CABLE GROUNDING KITS. FOLLOW THE MANUFACTURER'S RECOMMENDATIONS.
 - A. GROUNDING AT THE ANTENNA LEVEL.
 - B. GROUNDING AT MID LEVEL. TOWERS WHICH ARE OVER 200'-0", ADDITIONAL CABLE GROUNDING REQUIRED.
 - C. GROUNDING AT BASE OF TOWER PRIOR TO TURNING HORIZONTAL.
 - D. GROUNDING OUTSIDE THE EQUIPMENT SHELTER AT ENTRY PORT.
 - E. GROUNDING INSIDE THE EQUIPMENT SHELTER AT THE ENTRY PORT.
4. ALL PROPOSED GROUNDING BAR DOWNLEADS ARE TO BE TERMINATED TO THE EXISTING ADJACENT GROUNDING BAR DOWNLEADS A MINIMUM DISTANCE OF 4'-0" BELOW GROUNDING BAR. TERMINATIONS MAY BE EXOTHERMIC OR COMPRESSION.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ANTENNA AND THE COAX CONFIGURATION IS THE CORRECT MAKE AND MODELS, PRIOR TO INSTALLATION.
6. ALL CONNECTIONS FOR HANGERS, SUPPORTS, BRACING, ETC. SHALL BE INSTALLED PER TOWER MANUFACTURER'S SPECIFICATION & RECOMMENDATIONS.
7. CONTRACTOR SHALL REFERENCE THE TOWER STRUCTURAL ANALYSIS/DESIGN DRAWINGS FOR DIRECTIONS ON CABLE DISTRIBUTION/ROUTING.
8. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY ANTENNA, TMAS, DIPLEXERS, AND COAX CONFIGURATION, MAKE AND MODELS PRIOR TO INSTALLATION.
9. ALL CONNECTIONS FOR HANGERS, SUPPORTS, BRACING, ETC. SHALL BE INSTALLED PER TOWER MANUFACTURER'S RECOMMENDATIONS.
10. CONTRACTOR SHALL REFERENCE THE TOWER STRUCTURAL ANALYSIS/DESIGN DRAWINGS FOR DIRECTIONS ON CABLE DISTRIBUTION/ROUTING.
11. ALL OUTDOOR RF CONNECTORS/CONNECTIONS SHALL BE WEATHERPROOFED, EXCEPT THE RET CONNECTORS, USING BUTYL TAPE AFTER INSTALLATION AND FINAL CONNECTIONS ARE MADE. BUTYL TAPE SHALL HAVE A MINIMUM OF ONE-HALF TAPE WIDTH OVERLAP ON EACH TURN AND EACH LAYER SHALL BE WRAPPED THREE TIMES. WEATHERPROOFING SHALL BE SMOOTH WITHOUT BUCKLING. BUTYL BLEEDING IS NOT ALLOWED.
12. IF REQUIRED TO PAINT ANTENNAS AND/OR COAX:
 - A. TEMPERATURE SHALL BE ABOVE 50° F.
 - B. PAINT COLOR MUST BE APPROVED BY BUILDING OWNER/LANDLORD.
 - C. FOR REGULATED TOWERS, FAA/FCC APPROVED PAINT IS REQUIRED.
 - D. DO NOT PAINT OVER COLOR CODING OR ON EQUIPMENT MODEL NUMBERS.

STRUCTURAL STEEL NOTES

1. DESIGN AND CONSTRUCTION OF STRUCTURAL STEEL SHALL CONFORM TO THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION "SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS, ALLOWABLE STRESS DESIGN AND PLASTIC DESIGN".
2. STRUCTURAL STEEL WIDE FLANGE SHAPES SHALL CONFORM TO ASTM A992, "STEEL FOR STRUCTURAL SHAPES FOR USE IN BUILDING FRAMING", GRADE 50, UNLESS OTHERWISE INDICATED. IF THE MEMBER SIZES INDICATED ARE NOT AVAILABLE IN THIS GRADE, ASTM A572 "HIGH-STRENGTH LOW-ALLOY COLUMBIUM-VANADIUM STRUCTURAL STEEL", GRADE 50, MAY BE SUBSTITUTED.
3. HOLLOW STRUCTURAL SECTIONS (HSS) SHALL CONFORM TO ASTM A500 "COLD-FORMED WELDED & SEAMLESS CARBON STEEL STRUCTURAL TUBING IN ROUNDS AND SHAPES", GRADE B.
4. MISCELLANEOUS STEEL, INCLUDING CHANNELS, ANGLES, PLATES, AND BARS SHALL CONFORM TO ASTM A36 "CARBON STRUCTURAL STEEL", UNLESS OTHERWISE INDICATED.
5. ANCHOR BOLTS SHALL CONFORM TO ASTM F1554 "ANCHOR BOLTS, STEEL, 36, 55, AND 105-KSI YIELD STRENGTH", GRADE 36.
6. STRUCTURAL CONNECTION BOLTS SHALL BE HIGH STRENGTH BOLTS CONFORMING TO ASTM A325 "STRUCTURAL BOLTS, STEEL, HEAT TREATED, 120/105 KSI MINIMUM TENSILE STRENGTH". BOLTS SHALL BE 3/4 INCH DIAMETER, TYPE X, UNLESS OTHERWISE NOTED.
7. MATCHING NUTS SHALL BE HEAVY HEX TYPE, CONFORMING TO ASTM A563 "CARBON AND ALLOY STEEL NUTS". WASHERS, WHERE REQUIRED, SHALL CONFORM TO ASTM F436 "HARDENED STEEL WASHERS".
8. FIELD CONNECTIONS SHALL BE BOLTED UNLESS OTHERWISE INDICATED. ALL BOLTED CONNECTIONS SHALL BE MADE WITH NOT LESS THAN TWO (2) HIGH STRENGTH BOLTS, OR EQUIVALENT WELD.
9. STRUCTURAL CONNECTIONS SHALL BE SNUG TIGHT IN ACCORDANCE WITH THE RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS "SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS", UNLESS OTHERWISE NOTED.
10. BOLTS IN SLIP-CRITICAL CONNECTIONS SHALL BE FULLY PRETENSIONED BY THE TURN-OFF-NUT METHOD IN ACCORDANCE WITH THE RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS "SPECIFICATIONS FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS".
11. ANCHOR BOLTS SHALL BE TENSIONED BY THE TURN-OFF-NUT METHOD AFTER GROUING OF BASE PLATES.
12. CONTRACTOR SHALL COMPLY WITH AWS D1.1 "STRUCTURAL WELDING CODE - STEEL" FOR PROCEDURES, APPEARANCE AND QUALITY OF WELDS, AND FOR METHODS USED IN CORRECTING WELDING. ALL WELDERS AND WELDING PROCESSES SHALL BE QUALIFIED IN ACCORDANCE WITH AWS "STANDARD QUALIFICATION PROCEDURES". AS STEEL BAR
13. GRATING SHALL BE TYPE "W/B" GALVANIZED WELDED 1KG BORDEN, OR APPROVED EQUAL. BEARING BARS SHALL BE MANUFACTURED BY AS FOLLOWS:

GRATING	1" x 3/16"
SERRATED	
14. BAND ALL EDGES, AND ATTACH TO SUPPORTING MEMBERS AT 18" ON CENTER WITH MODEL GG GALVANIZED G-CLIPS AS MANUFACTURED BY GRATING FASTENERS INC.
15. EXPANSION ANCHORS SHALL BE HILTI KWIK BOLT III OR APPROVED EQUAL. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. MINIMUM EMBEDMENT SHALL BE 4-3/4" UNLESS OTHERWISE NOTED.
16. EPOXY ANCHOR ASSEMBLIES SHALL BE AS MANUFACTURED BY HILTI OR ENGINEER APPROVED EQUAL, AS FOLLOWS:

ANCHOR SYSTEM	CONCRETE OR GROUDED CMU	HIT HY-150
		HIT HY-20
17. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S WRITTEN INSTRUCTIONS.
18. ALL INTERIOR STRUCTURAL STEEL SHALL BE SHOP PRIME COATED WITH A RUST-INHIBITIVE PRIMER EXCEPT AREAS TO BE FIREPROOFED NEED NOT BE PAINTED. SURFACE PREPARATION SHALL BE IN ACCORDANCE WITH THE PAINT MANUFACTURER'S RECOMMENDATIONS. AREAS WHICH MAY BE INACCESSIBLE AFTER INSTALLATION SHALL RECEIVE TWO (2) COATS OF PRIMER. SEE ARCHITECTURAL DRAWINGS FOR FINISH PAINT.
19. FIELD CONNECTIONS AND DAMAGED OR ABRADED AREAS OF SHOP PRIME COAT SHALL BE TOUCH-UP PAINTED WITH COMPATIBLE FIELD PRIMER.
20. ALL EXTERIOR STEEL SHALL BE GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH ASTM A123 "ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL PRODUCTS", UNLESS OTHERWISE NOTED. ALL EXTERIOR BOLTS AND MISCELLANEOUS HARDWARE SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153 "ZINC COATING (HOT-DIP) ON IRON AND STEEL HARDWARE", UNLESS OTHERWISE NOTED.
21. DAMAGED GALVANIZED SURFACES SHALL BE REPAIRED BY COLD GALVANIZING IN ACCORDANCE WITH ASTM A780 "REPAIR OF DAMAGED AND UNCOATED AREAS OF HOT-DIP GALVANIZED COATINGS".
22. ALL STEEL WORK SHALL BE SUBJECT TO SPECIAL INSPECTIONS DURING CONSTRUCTION.
23. THE NOTES CONTAINED HEREIN ARE NOT PROJECT SPECIFIC. THE CONTRACTOR SHALL UTILIZE ALL NOTES WHICH SOLELY PERTAIN TO THE WORK DEPICTED ON THESE DRAWINGS.

FIBER & POWER CABLE MOUNTING NOTES

1. THE FIBER OPTIC TRUNK CABLES SHALL BE INSTALLED INTO CONDUITS, CHANNEL CABLE TRAYS, OR CABLE TRAY. WHEN INSTALLING FIBER OPTIC TRUNK CABLES INTO A CABLE TRAY SYSTEM, THEY SHALL BE INSTALLED INTO AN INTER DUCT AND A PARTITION BARRIER SHALL BE INSTALLED BETWEEN THE 600 VOLT CABLES AND THE INTER DUCT IN ORDER TO SEGREGATE CABLE TYPES. OPTIC FIBER TRUNK CABLES SHALL HAVE APPROVED CABLE RESTRAINTS EVERY (60) SIXTY FEET AND SECURELY FASTENED TO THE CABLE TRAY SYSTEM. NFPA 70 (NEC) ARTICLE 770 RULES SHALL APPLY.
2. THE TYPE TC-ER CABLES SHALL BE INSTALLED INTO CONDUITS, CHANNEL CABLE TRAYS, OR CABLE TRAY AND SHALL BE SECURED AT INTERVALS NOT EXCEEDING (6) SIX FEET. AN EXCEPTION; WHERE TYPE TC-ER CABLES ARE NOT SUBJECT TO PHYSICAL DAMAGE, CABLES SHALL BE PERMITTED TO MAKE A TRANSITION BETWEEN CONDUITS, CHANNEL CABLE TRAYS, OR CABLE TRAY WHICH ARE SERVING UTILIZATION EQUIPMENT OR DEVICES, A DISTANCE (6) SIX FEET SHALL NOT BE EXCEEDED WITHOUT CONTINUOUS SUPPORTING. NFPA 70 (NEC) ARTICLES 336 AND 392 RULES SHALL APPLY.
3. WHEN INSTALLING OPTIC FIBER TRUNK CABLES OR TYPE TC-ER CABLES INTO CONDUITS, NFPA 70 (NEC) ARTICLE 300 RULES SHALL APPLY.

ANTENNA MOUNTING NOTES

1. DESIGN AND CONSTRUCTION OF ANTENNA SUPPORTS SHALL CONFORM TO CURRENT ANSI/TIA-222 OR APPLICABLE LOCAL CODES.
2. ALL STEEL MATERIALS SHALL BE GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH ASTM A123 "ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL PRODUCTS", UNLESS NOTED OTHERWISE.
3. ALL BOLTS, ANCHORS AND MISCELLANEOUS HARDWARE SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153 "ZINC-COATING (HOT-DIP) ON IRON AND STEEL HARDWARE", UNLESS NOTED OTHERWISE.
4. DAMAGED GALVANIZED SURFACES SHALL BE REPAIRED BY COLD GALVANIZING IN ACCORDANCE WITH ASTM A780.
5. ALL ANTENNA MOUNTS SHALL BE INSTALLED WITH LOCK NUTS, DOUBLE NUTS AND SHALL BE TORQUED TO MANUFACTURER'S RECOMMENDATIONS.
6. CONTRACTOR SHALL INSTALL ANTENNA PER MANUFACTURER'S RECOMMENDATION FOR INSTALLATION AND GROUNDING.
7. ALL UNUSED PORTS ON ANY ANTENNAS SHALL BE TERMINATED WITH A 50-OHM LOAD TO ENSURE ANTENNAS PERFORM AS DESIGNED.
8. PRIOR TO SETTING ANTENNA AZIMUTHS AND DOWNTILTS, ANTENNA CONTRACTOR SHALL CHECK THE ANTENNA MOUNT FOR TIGHTNESS AND ENSURE THAT THEY ARE PLUMB. ANTENNA AZIMUTHS SHALL BE SET FROM TRUE NORTH AND BE ORIENTED WITHIN +/- 5% AS DEFINED BY THE RFDS. ANTENNA DOWNTILTS SHALL BE WITHIN +/- 0.5% AS DEFINED BY THE RFDS. REFER TO ND-00246.
9. JUMPERS FROM THE TMA'S MUST TERMINATE TO OPPOSITE POLARIZATION'S IN EACH SECTOR.
10. CONTRACTOR SHALL RECORD THE SERIAL #, SECTOR, AND POSITION OF EACH ACTUATOR INSTALLED AT THE ANTENNAS AND PROVIDE THE INFORMATION TO AT&T.
11. TMA'S SHALL BE MOUNTED ON PIPE DIRECTLY BEHIND ANTENNAS AS CLOSE TO ANTENNA AS FEASIBLE IN A VERTICAL POSITION.
12. ANTENNAS SHALL HAVE A 4'-0" MIN CENTER TO CENTER HORIZONTAL SEPARATION (U.N.O.).

TORQUE REQUIREMENTS

1. ALL RF CONNECTIONS SHALL BE TIGHTENED BY A TORQUE WRENCH.
2. ALL RF CONNECTIONS, GROUNDING HARDWARE AND ANTENNA HARDWARE SHALL HAVE A TORQUE MARK INSTALLED IN A CONTINUOUS STRAIGHT LINE FROM BOTH SIDES OF THE CONNECTION.
 - A. RF CONNECTION BOTH SIDES OF THE CONNECTOR.
 - B. GROUNDING AND ANTENNA HARDWARE ON THE NUT SIDE STARTING FROM THE THREADS TO THE SOLID SURFACE. EXAMPLE OF SOLID SURFACE: GROUND BAR, ANTENNA BRACKET METAL.
3. ALL 8M ANTENNA HARDWARE SHALL BE TIGHTENED TO 9 LB-FT (12 NM).
4. ALL 12M ANTENNA HARDWARE SHALL BE TIGHTENED TO 43 LB-FT (58 NM).
5. ALL GROUNDING HARDWARE SHALL BE TIGHTENED UNTIL THE LOCK WASHER COLLAPSES AND THE GROUNDING HARDWARE IS NO LONGER LOOSE.
6. ALL DIN TYPE CONNECTIONS SHALL BE TIGHTENED TO 18-22 LB-FT (24.4 - 29.8 NM).
7. ALL N TYPE CONNECTIONS SHALL BE TIGHTENED TO 15-20 LB-IN (1.7 - 2.3 NM).



NEW CINGULAR WIRELESS PCS, LLC
340 MOUNT KEMBLE AVENUE
MORRISTOWN, NJ 07960



BLACK & VEATCH

BLACK & VEATCH CORPORATION
45 EISENHOWER DRIVE SUITE 240
PARAMUS, NJ 07652



- PLANNING
- ENGINEERING
- SURVEYING
- CONSTRUCTION MANAGEMENT


TECTONIC Engineering & Surveying Consultants P.C.
1279 ROUTE 300
Newburgh, NY 12550
Phone: (845) 587-8858
Fax: (845) 587-8703
www.tectoniceengineering.com

PROJECT NO: 6307.321G4041

DRAWN BY: MT

CHECKED BY: MP

REV	DATE	DESCRIPTION
	11/28/12	ISSUED FOR PERMIT

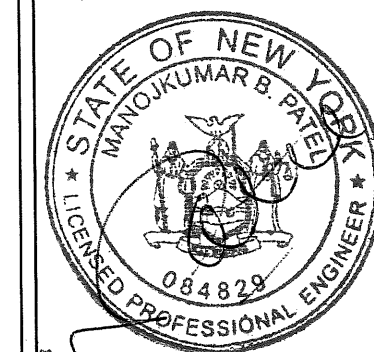

UNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING A LICENSED ENGINEER'S OR SURVEYOR'S SEAL IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK STATE EDUCATION LAW.

SITE NAME: MIDDLE HOPE
SITE #: 321G4041
ADDR: 21 BANNERMAN VIEW DR
NEWBURGH, NY 12550
LTE

SHEET TITLE
NOTES

SHEET NUMBER
GN-1

