

ORANGE COUNTY DEPARTMENT OF HEALTH  
DIVISION OF ENVIRONMENTAL HEALTH

August 31, 1973

These plans for Sandy's Place Restaurant, Sewage Disposal System,  
T. Newburgh

are hereby approved pursuant to Article 12 of the Public Health Law subject to the  
provisions of the permit issued this day.

ASSISTANT COMMISSIONER


*[Signature]*

SEWAGE DISPOSAL SYSTEM

FOR  
SANDY'S RESTAURANT

TOWN OF NEWBURGH,  
ORANGE CO. NEW YORK

OWNER:  
SANDY MARTIN  
RTE 32 HOLTS CORNER  
P.O. BOX 2095  
NEWBURGH, N.Y. 12550

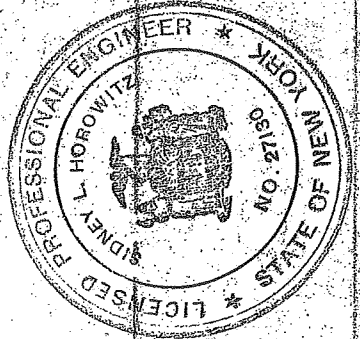


BY *[Signature]*  
TPE #LS 27130

10-MAG-73  
REV 9 JUNE 73  
SCALE: 1"=20'  
REV 17 AUG 73

5 1/2" 56' W  
163'

NY 5  
RTE 32

WATER SUPPLY  
APPROX. LOCATION  
WATER MAIN

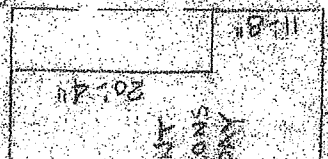


NOTES FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM  
 1. SEPTIC TANKS TO BE 50% COVER ON EQUAL  
 COMMON STANDARDS 177 BE SHOWN ON SEWER  
 TO TANK TO BE 4" COST FROM SLOPE IN PER FT.  
 BE LINE FROM TANK TO TILE FIELDS SHALL  
 WITH TIGHT JOINTS & SLOPED 1/8" PER FT.  
 LEACHING TRENCH SHALL BE 36" IN WIDTH  
 PERFORATED DRAINAGE BURCH PIPE SLOPE 1/16"  
 PER FT. LEACHING TRENCH SHALL BE SPOCED  
 MIN 5' O.C. GRADINGS IN LEACHING AREA  
 SHALL NOT EXCEED 1/10" CUT OR FILL

SOIL PERCOLATION TEST INDICATED 1" DEEP  
 FROM 6" TO 5" IN AVERAGE OF 47 MINUTES ON 16 AUG. 75.  
 SEWAGE APPLICATION RATE OF GAL PER SQ. FT. PER DAY


WATER SUPPLY IS MUNICIPAL FROM TOWN OF NEWBURGH WATER M.

DETAIL  
 LEACHING TRENCH  
 1/2" SCALE

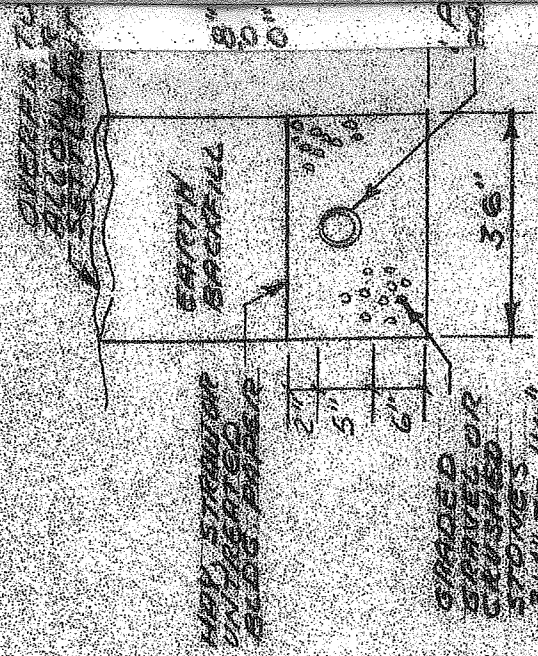


INLET

S 46° 48' 30" E

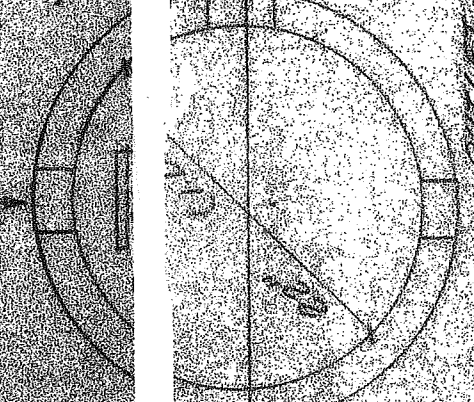


REMOVABLE  
 COVER

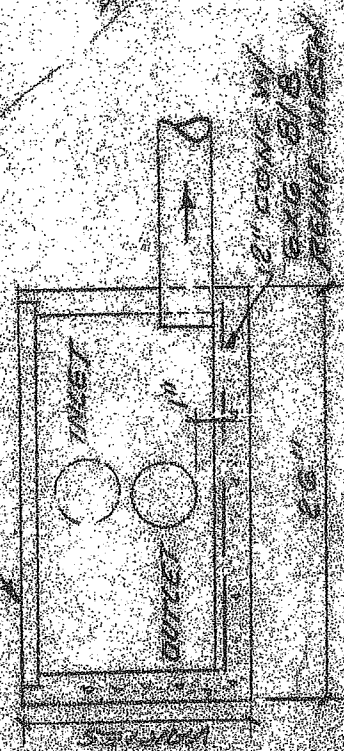

DISTRIBUTION BOX DETAIL  
 1/2\"/>

GENERAL NOTES

1. NO GRAVITY IN EXCESS OF ONE FOOT TO BE MADE IN THE AREA
2. CELLULARS TO BE 50 SQ. FT. IN LENGTH AND NOT TO EXCEED 60" IN ANY LINE
3. IF GARAGE GENDERS ARE USED, SIZE OF SEPTIC TANK IS TO BE INCREASED BY 50%
4. TILE FIELD TO DRAINAGE DITCH OR UNDERDRAINS - 25 FT. MINIMUM
5. DRIVEWAYS TO BE LOCATED 50' FROM TO AND TILE FIELDS
6. CELLAR ROOM AND FOOTING DETAILS WILL NOT BE CHANGED IN ANY OF TILE FIELD

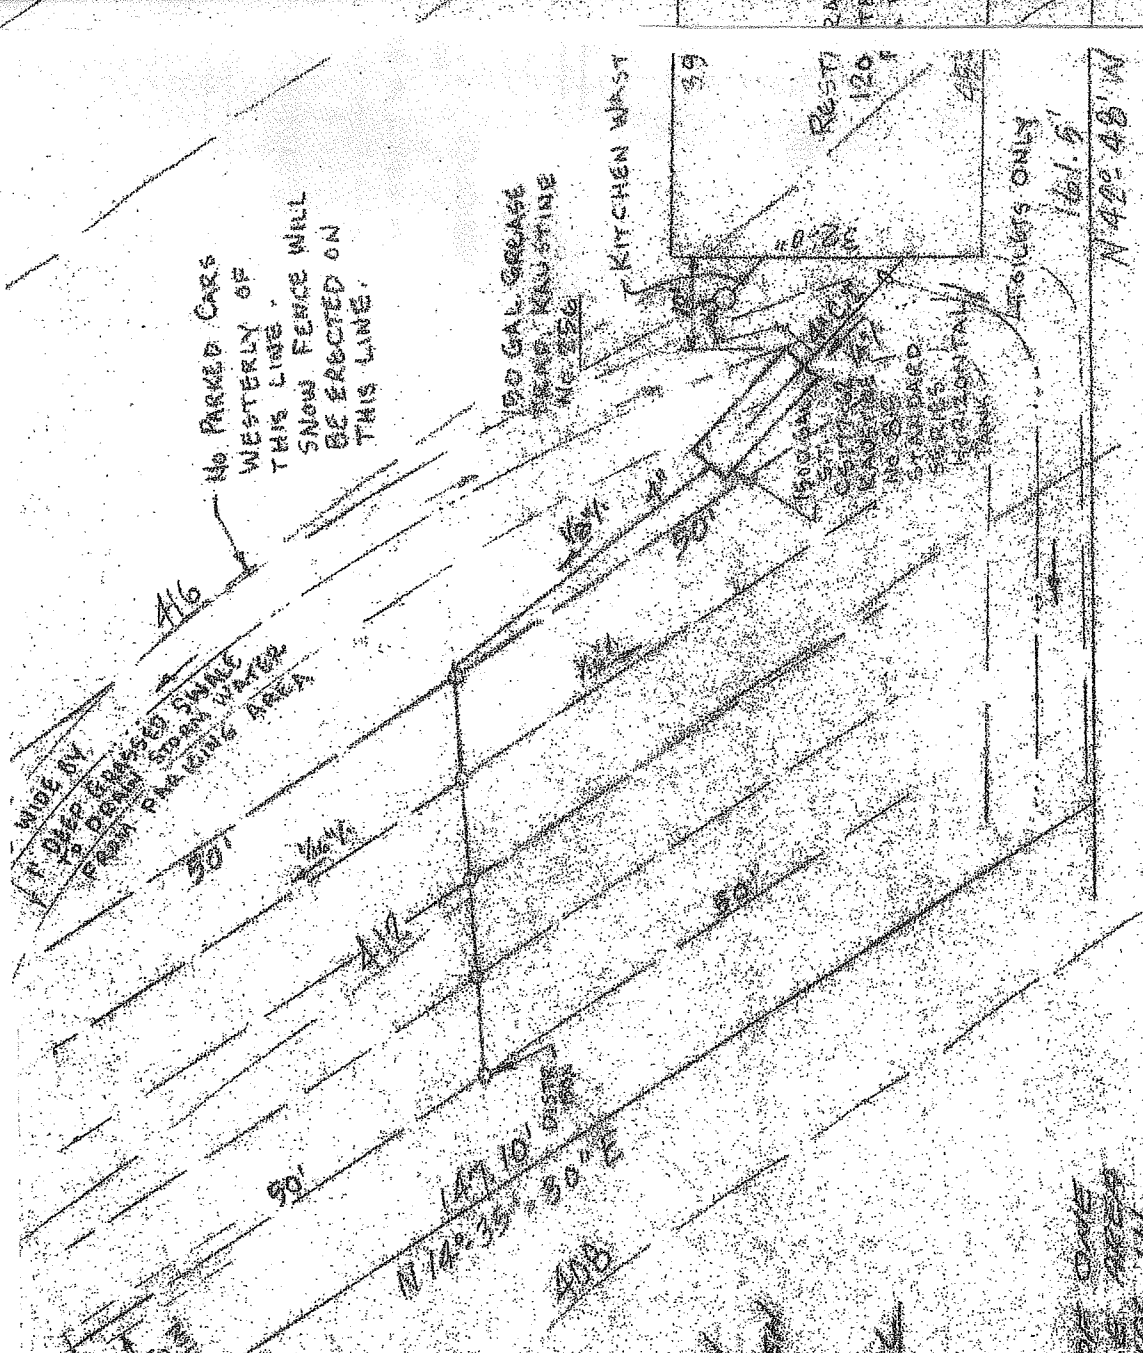

NO PARKED CARS  
 WESTERLY OF  
 THIS LINE.  
 SNOW FENCE WILL  
 BE ERCTED ON  
 THIS LINE.

150 GAL. GREASE  
 TRAP, KNUSTINE  
 NO. 256

KITCHEN WAST

1500 GAL. 15\"/>

AT TICKETS ONLY  
 161.5'

N 42° 48' W

NYS  
 RTE 300